

Weather station Standard 15011

Overview


For the calculation of the PR (Performance Ratio) the Irradiation (W/m²), the ambient temperature and the Module surface temperature are needed. In this version the wind speed and wind direction sensors are also included.

Interfaces

- Lonworks (field devices)
- O&M Handheld Terminal
- 24 V DC Aux. supply

Functionality

- Irradiation (Pyranometer) sensor
- Module surface Temperature
- Ambient Temperature sensor
- Wind speed sensor
- Wind direction sensor
- I/O Module (Lonworks) to connection to Control room or Inverter room

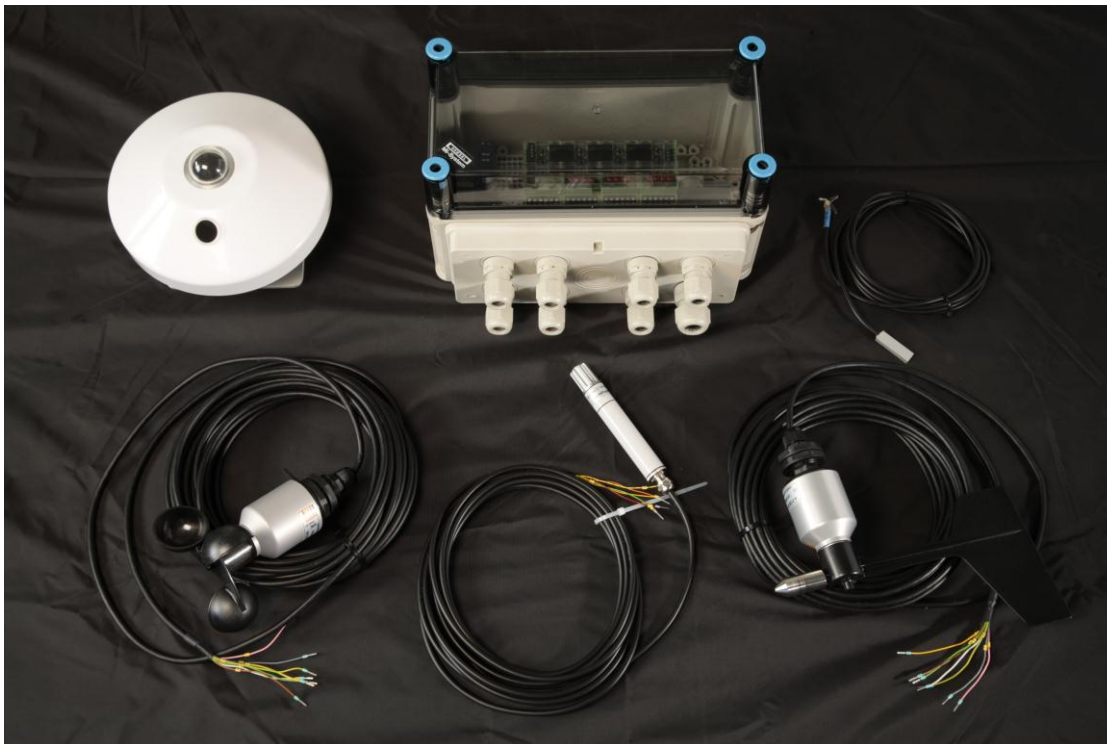

Rev 2.1 : 06/12 : subject to changes

